


CONCRETE SIDEWALK DETAIL

NTS

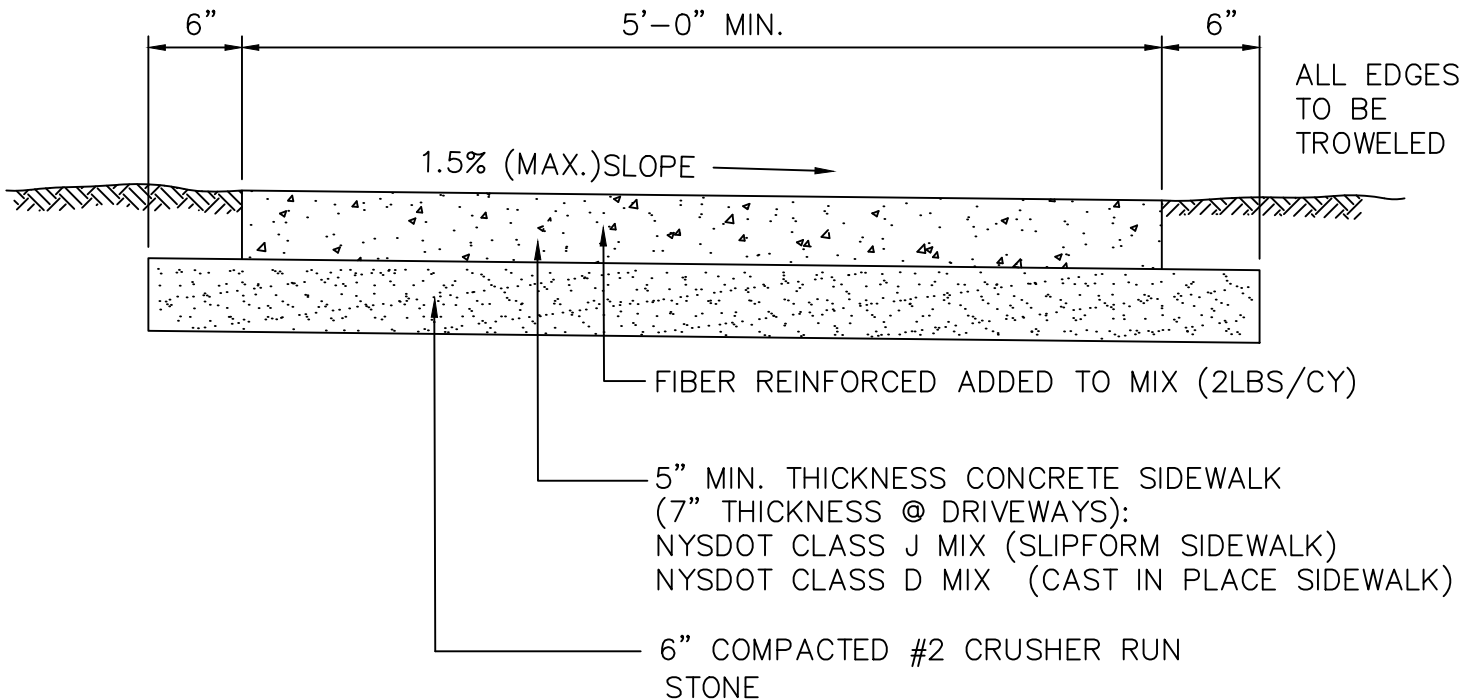

NOTES:

1. CONSTRUCTION EXPANSION JOINTS TO BE INSTALLED EVERY 25 FEET.
2. DUMMY JOINTS MINIMUM 1" DEEP TO BE SCORED EVERY 5 FEET.
3. ALL EXPOSED CONCRETE SURFACES SHALL BE BROOM FINISHED.
4. ALL EXPOSED CONCRETE TO RECEIVE TWO COATS OF A COMBINATION CURING COMPOUND-SEALER.
5. ALL WORK SHALL CONFORM TO ADA REQUIREMENTS

*SPECIAL NOTE

UNLESS OTHERWISE APPROVED BY THE COMMISSIONER OF PUBLIC WORKS, AT NO TIME SHALL THE SIDEWALK BACK EDGE BE LOWER THAN THE EDGE OF PAVEMENT OF ADJACENT ROADWAYS. ALL SIDEWALKS SHALL BE DESIGNED TO ALLOW FOR POSITIVE DRAINAGE OF ROADWAYS OR ADJACENT PROPERTIES AND NOT CREATE A BARRIER FOR POSITIVE DRAINAGE. PROPER DRAINAGE MAY BE MAINTAINED THROUGH THE USE OF YARD INLETS OR PROPER SIZE STORM CROSSOVER PIPE OF ADEQUATE LENGTH WITH END SECTIONS.