


# COLLECTOR ROAD SECTION

NTS  
80' R.O.W.

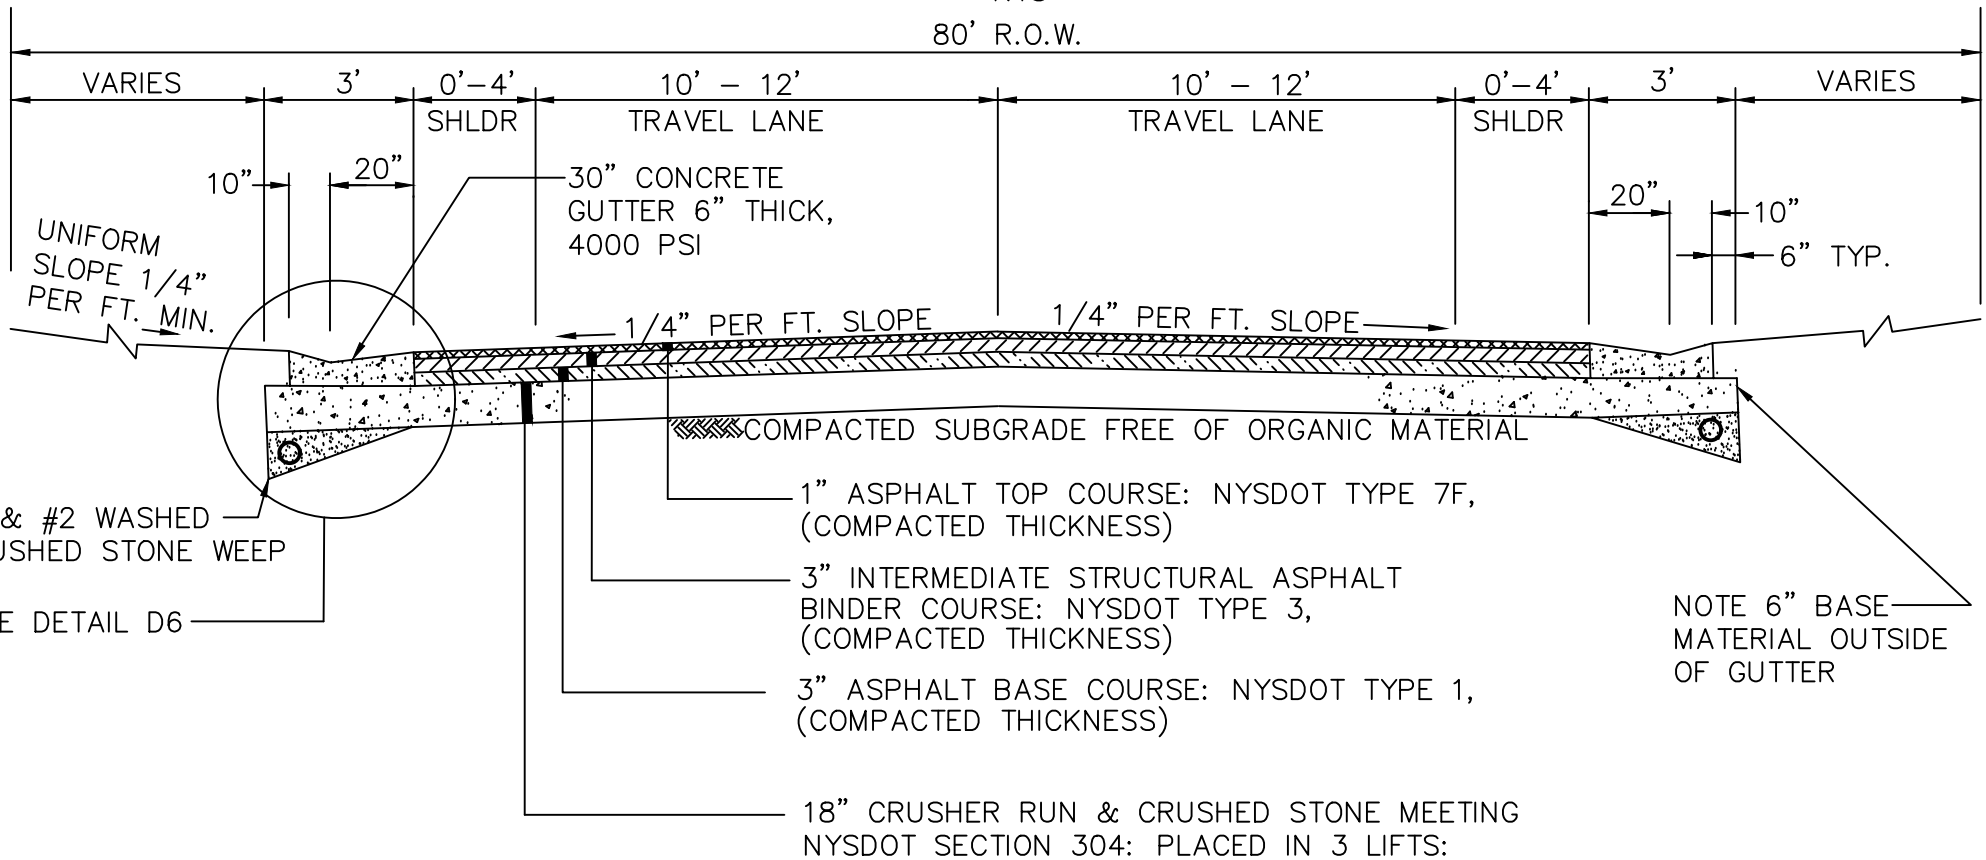

NOTE 6" BASE MATERIAL OUTSIDE OF GUTTER

- 18" CRUSHER RUN & CRUSHED STONE MEETING NYSDOT SECTION 304: PLACED IN 3 LIFTS:
- 1ST 9" OF #3 CRUSHED STONE
  - 2ND 6" OF #2 CRUSHER RUN
  - 3RD 3" OF #1 CRUSHED RUN

## NOTES:

1. THESE ARE MINIMUM SPECIFICATIONS. A SOIL INVESTIGATION IS REQUIRED TO SUPPORT A FINAL DECISION ON THE ROAD SECTION. THE COMMISSIONER OF PUBLIC WORKS, WITH INPUT FROM THE DESIGN ENGINEER, SHALL DETERMINE THE ASPHALT MATERIALS.
2. SUB-GRADE MUST FREE DRAIN TO STONE WEEP. A 10' PIECE OF 4" PERFORATED DRAIN PIPE WITH END CAP EXTENDS INTO THIS WEEP FROM EACH CATCH BASIN.
3. IF ORGANIC MATERIAL IS ENCOUNTERED IN THE ROAD BOX SUBGRADE IT WILL BE EXCAVATED OUT AND REPLACED WITH #2 CRUSHER RUN STONE TO DRAIN TO THE STONE WEEP UNDERDRAIN.
4. THE ROADBOX SUBGRADE AND SUBBASE MATERIAL SHALL BE COMPACTED TO 95% MODIFIED PROCTOR UTILIZING A 10-TON VIBRATORY ROLLER WITH A VIBRATORY FORCE OF 27,000 LBS.